




CONDENSATE FROM FUME HOODS ARE
COLLECTED IN THE COLLECTION TANK IN
THE GROUND FLOOR OUTSIDE THE
BUILDING

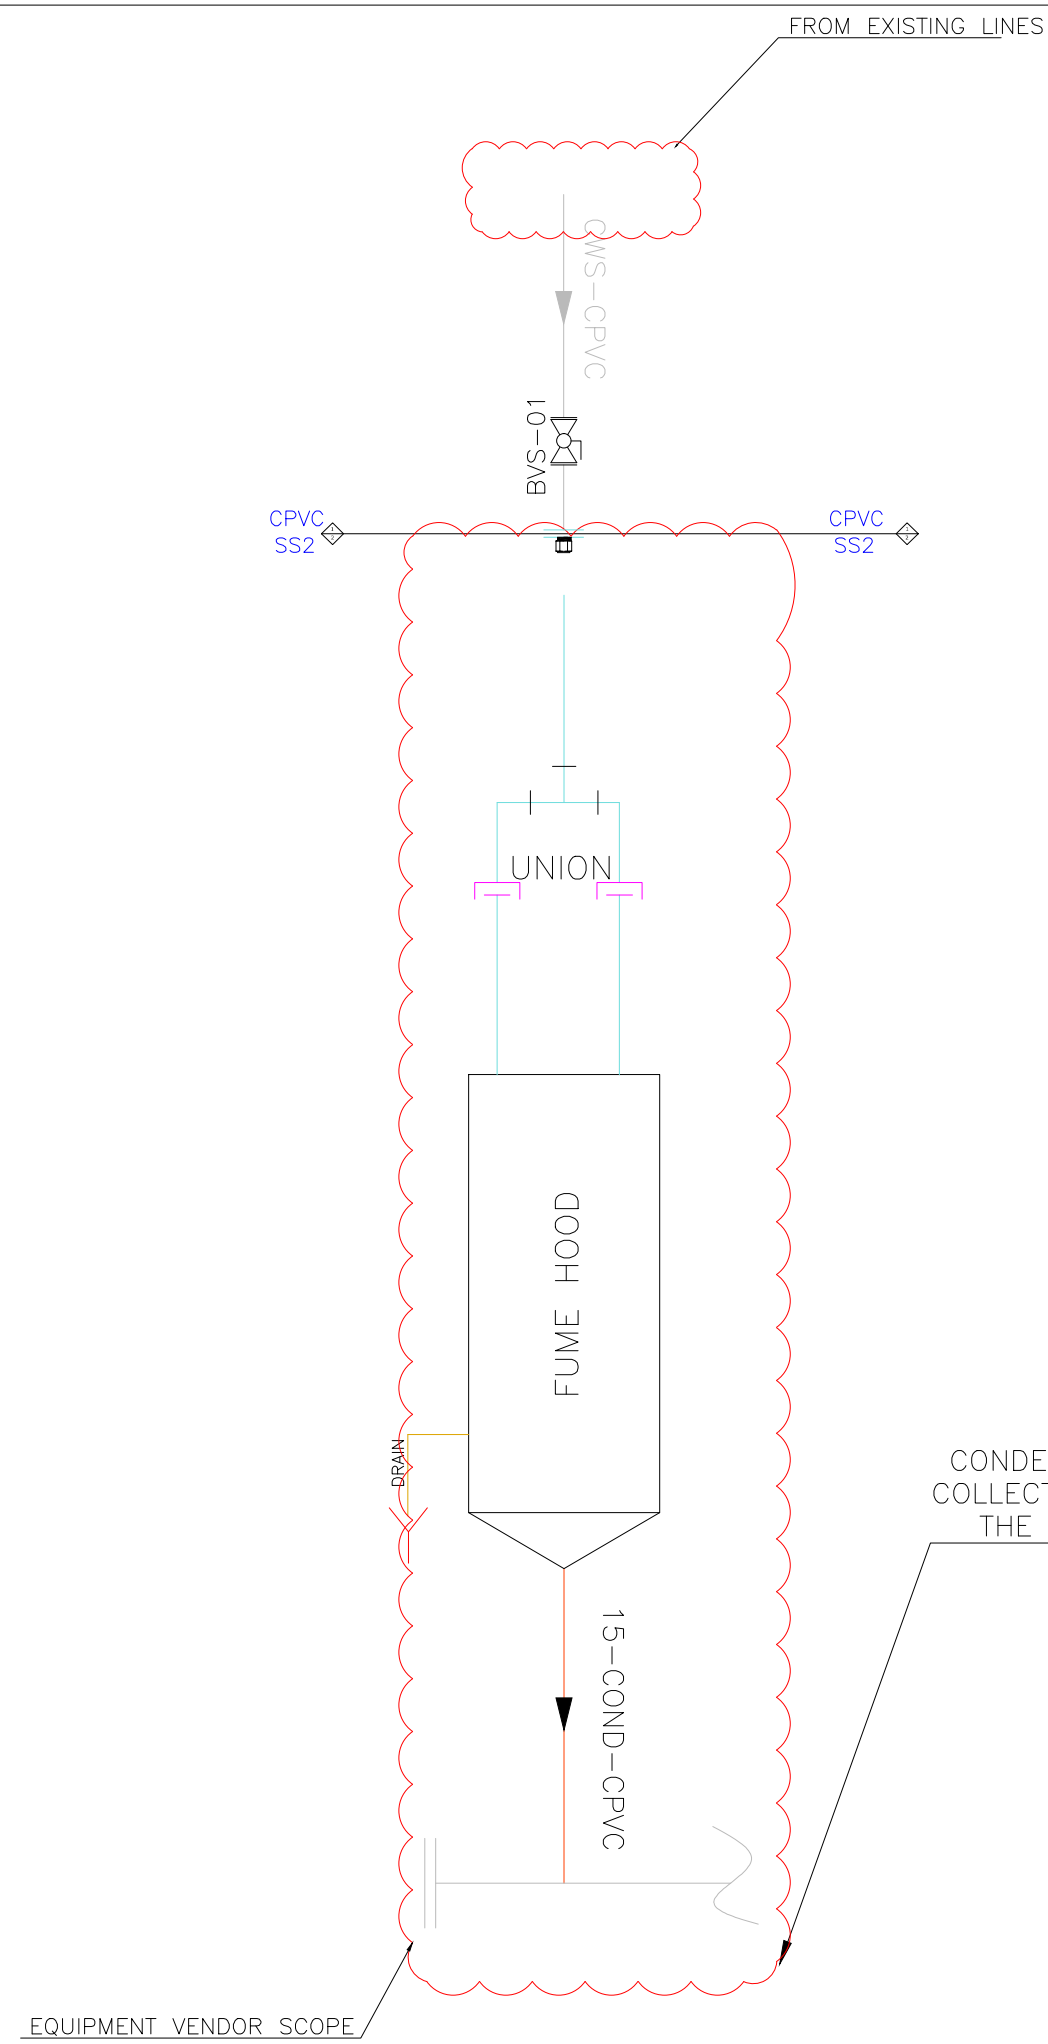

CONDENSATE FROM FUME HOODS ARE
COLLECTED IN THE COLLECTION TANK IN
THE GROUND FLOOR OUTSIDE THE
BUILDING

CWS COOLING WATER SUPPLY

LEGEND	
SS2	SS316-CWS-CPVC
SS1	SS304
CPVC	CHLORINATED POLYVINYL CHLORIDE
PIPE IDENTIFICATION	
PIPE SIZE	MO
SERVICE	
VALVE IDENTIFICATION	
1. VALVE SPECIFICATION	
VALVE TYPE	BV- 01
2. NV - NEEDLE VALVE	TAG NO.
3. BV - BALL VALVE	
4. CV - NON RETURN VALVE	

CLIENT:	 INDIAN INSTITUTE OF SCIENCE, BANGALORE.	Architect: Chandroo Iyer Associates NO 69, 15TH "A" CROSS, 6th MAIN MALLSWARAM BANGALORE 560 053 TEL - 80 - 23360319	Consultant:  M J ASSOCIATES PROJECT ENGINEERING CONSULTANTS 84/5, 1st Floor, 8th Main road, Vasanth nagar, Bangalore-560 052 Tele-22284583, 22204636 E-mail - projects@mjasociates.in, www.mjasociates.in	DRAWN	ABHI
				CHECKED	BGK
PROJECT: LABORATORY INTERIOR WORKS FOR CHEMICAL SCIENCES BUILDING.	DRAWING TITLE: P&ID FOR COOLING TOWER WATER FOR SSCU-2	DRAWING STATUS : TENDER DRAWINGS	APPROVED	SUNDAR	
			DATE	24.03.2019	
			JOB NO	MJ - 324	
			DWG NO:	4826(h)	
			SCALE	NTS	
			REVISION	TR 0	