




TAPPING FROM EXISTING HEADER

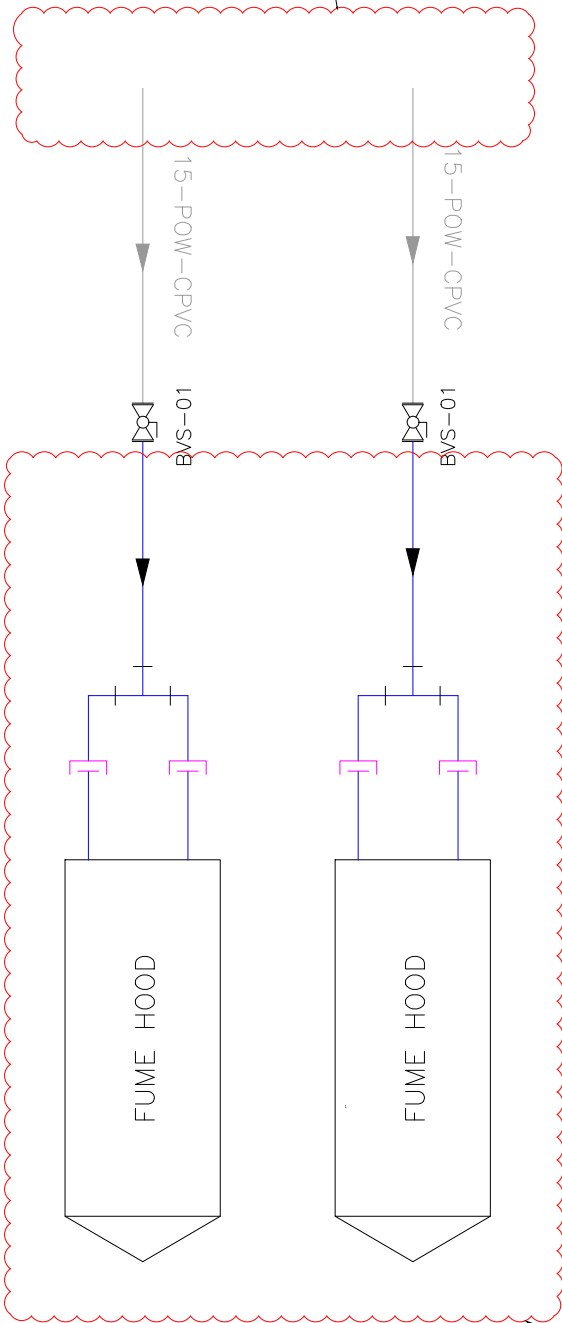

EQUIPMENT VENDOR SCOPE

LEGEND	
POW	POTABLE WATER
SS2	SS316
SS1	SS304
CPVC	CHLORINATED POLYVINYL CHLORIDE
PIPE IDENTIFICATION	
PIPE SIZE	15-POW-CPVC
SERVICE	MOC
VALVE IDENTIFICATION	
1. VALVE SPECIFICATION	
VALVE TYPE	BY- 01
2. NV - NEEDLE VALVE	TAG NO.
3. BV - BALL VALVE	
4. CV - NON RETURN VALVE	

CLIENT: <div> Indian Institute of Science Bangalore</div> <b>INDIAN INSTITUTE OF SCIENCE, BANGALORE.</b>	Architect: <b>Chandroo Iyer Associates</b> <small>NO. 69, 15TH "A" CROSS, 6TH MAIN MALLESWARAM BANGALORE - 560 055 TEL - 80 - 23368319</small>	DRAWN	ABHI
		CHECKED	BGK
		APPROVED	SUNDAR
		DATE	24.03.2019
<b>PROJECT:</b>  LABORATORY INTERIOR WORKS FOR CHEMICAL SCIENCES BUILDING.	Consultant: <div> <b>M J ASSOCIATES</b> PROJECT ENGINEERING CONSULTANTS #45, 1st Floor, 8th Main Road, Vasanth Nagar, Bangalore-560 052 Tel:-22284583, 22204636 E-mail-projects@mjassociates.in/www.mjassociates.in</div>	JOB NO	MJ - 324
		DWG NO:	4825(i)
		SCALE	NTS
		REVISION	TR 0
		DRAWING TITLE:  <b>P&amp;ID FOR POTABLE WATER (IPC-13)</b>	
		DRAWING STATUS : TENDER DRAWINGS	